

Šilumos šaltinių šildymo sezono
temperatūrinis grafikas.
Jurbarko miestas

SUDERINTA


Jurbarko rajono savivaldybės
Administracijos direktorius
Raimundas Bastys
2021 m.

TVIRTINU

AB „Kauno energija“
Generalinis direktorius
Tomas Garasimavičius
2021 m.

Toro, °C	Tt, °C	Tg, °C
10	70,0	40,0
9	70,0	40,0
8	70,0	40,0
7	70,0	40,0
6	70,0	40,0
5	70,0	40,0
4	70,0	40,0
3	70,0	40,0
2	70,0	40,0
1	70,0	40,0
0	70,0	40,0
-1	70,0	40,0
-2	70,0	40,0
-3	70,0	41,0
-4	70,0	41,0
-5	70,0	41,0
-6	74,0	43,0
-7	74,0	43,0
-8	74,0	43,0
-9	74,0	43,0
-10	74,0	43,0
-11	78,0	45,0
-12	78,0	45,0
-13	78,0	45,0
-14	78,0	45,0
-15	78,0	45,0
-16	82,0	47,0
-17	82,0	47,0
-18	82,0	47,0
-19	82,0	47,0
-20	82,0	47,0
-21	82,0	47,0
-22	85,0	48,0

Temperatūrinis grafikas pagal 85-70 °C
Skaičiuotina patalpų temperatūra 18 °C

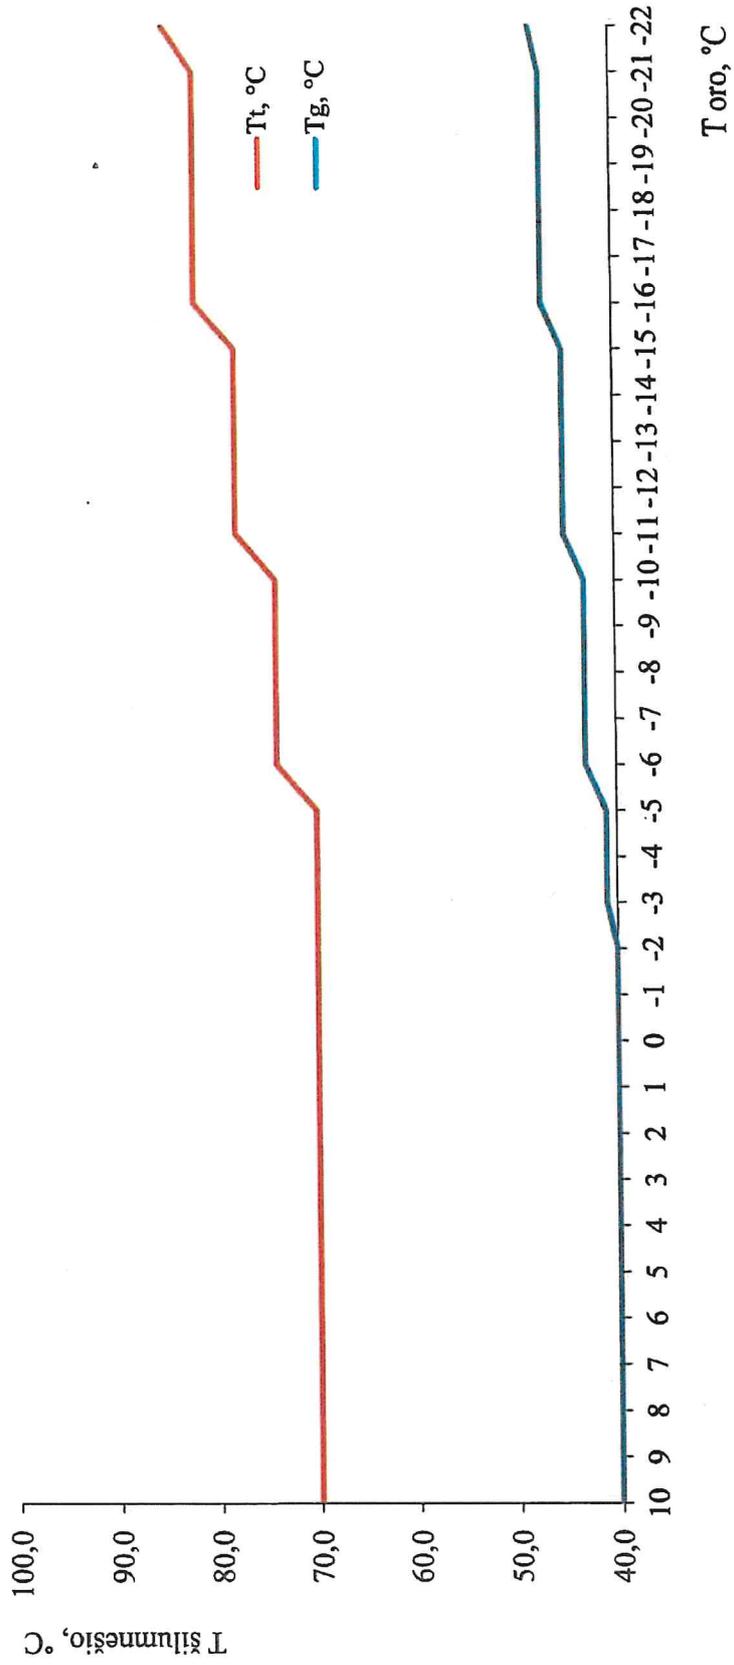

Tinklo valdymo skyriaus vadovas

Audrius Pupininkas