


MAINTENANCE ACCESS SHOULD  
 BE PROVIDED TO ALL FOUR SIDES OF  
 THE FILTER, SIZED TO SUIT LOCAL  
 REGULATIONS, TYPICALLY  
 1000 mm, BUT NOT LESS THAN 600 mm.

WE RESERVE THE RIGHT THAT WITHOUT  
 ANY NOTICE TO CHANGE  
 THE DESIGN OF THE EQUIPMENT

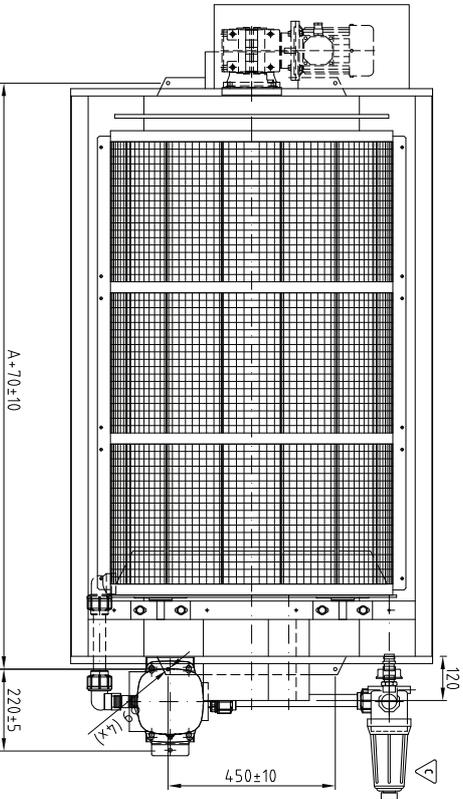

TYPE	A	B
801	700	200
802	1110	250
803	1520	250

C	New strainer (S 315 32)	080901	Mahd	178
Ed	Change and/or message no.	Date	Made by	cm no.

Part no.	Quantity	Name	Material	Scale	Revision	Remark
Design	Entry	ADN	ISO 2768-m	1:10		
<b>HYDROTECH</b>						
Measure drawing (803 drawn) Drumfilter 800-1H						
315 Edition C						050613